
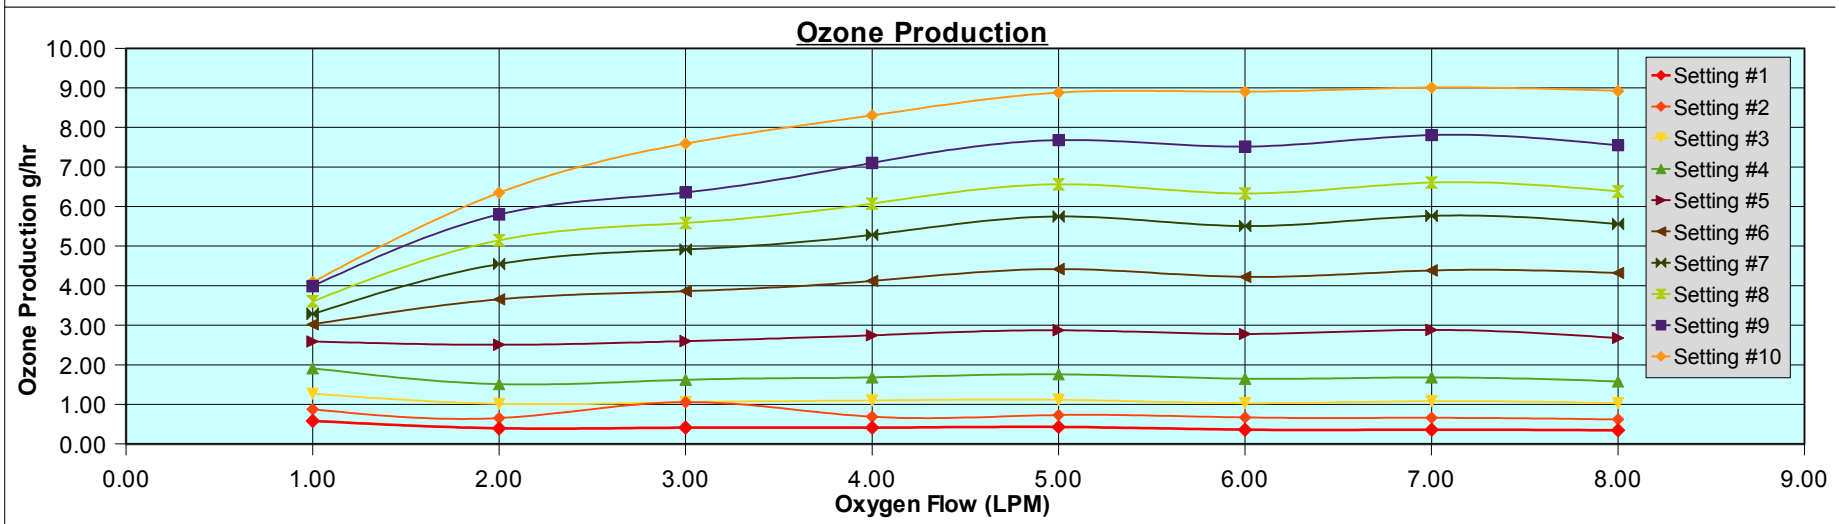


Ozone Generator Performance Chart

OZV-8S Ozone Generator

LPM Oxygen	% O3	g/hr	% O3	g/hr	% O3	g/hr	% O3	g/hr	% O3	g/hr	% O3	g/hr	% O3	g/hr	% O3	g/hr	% O3	g/hr	% O3	g/hr
	Setting #1		Setting #2		Setting #3		Setting #4		Setting #5		Setting #6		Setting #7		Setting #8		Setting #9		Setting #10	
1.00	0.68	0.58	1.02	0.88	1.48	1.27	2.23	1.91	3.02	2.59	3.52	3.02	3.83	3.29	4.20	3.60	4.65	3.99	4.77	4.09
2.00	0.23	0.39	0.38	0.65	0.59	1.01	0.88	1.51	1.46	2.51	2.13	3.66	2.65	4.55	3.00	5.15	3.38	5.80	3.70	6.35
3.00	0.16	0.41	0.41	1.06	0.41	1.06	0.63	1.62	1.01	2.60	1.50	3.86	1.91	4.92	2.17	5.59	2.47	6.36	2.95	7.59
4.00	0.12	0.41	0.20	0.69	0.32	1.10	0.49	1.68	0.80	2.75	1.20	4.12	1.54	5.29	1.77	6.07	2.07	7.10	2.42	8.31
5.00	0.10	0.43	0.17	0.73	0.26	1.12	0.41	1.76	0.67	2.87	1.03	4.42	1.34	5.75	1.53	6.56	1.79	7.68	2.07	8.88
6.00	0.07	0.36	0.13	0.67	0.20	1.03	0.32	1.65	0.54	2.78	0.82	4.22	1.07	5.51	1.23	6.33	1.46	7.52	1.73	8.91
7.00	0.06	0.36	0.11	0.66	0.18	1.08	0.28	1.68	0.48	2.88	0.73	4.38	0.96	5.77	1.10	6.61	1.30	7.81	1.50	9.01
8.00	0.05	0.34	0.09	0.62	0.15	1.03	0.23	1.58	0.39	2.68	0.63	4.32	0.81	5.56	0.93	6.38	1.10	7.55	1.30	8.92

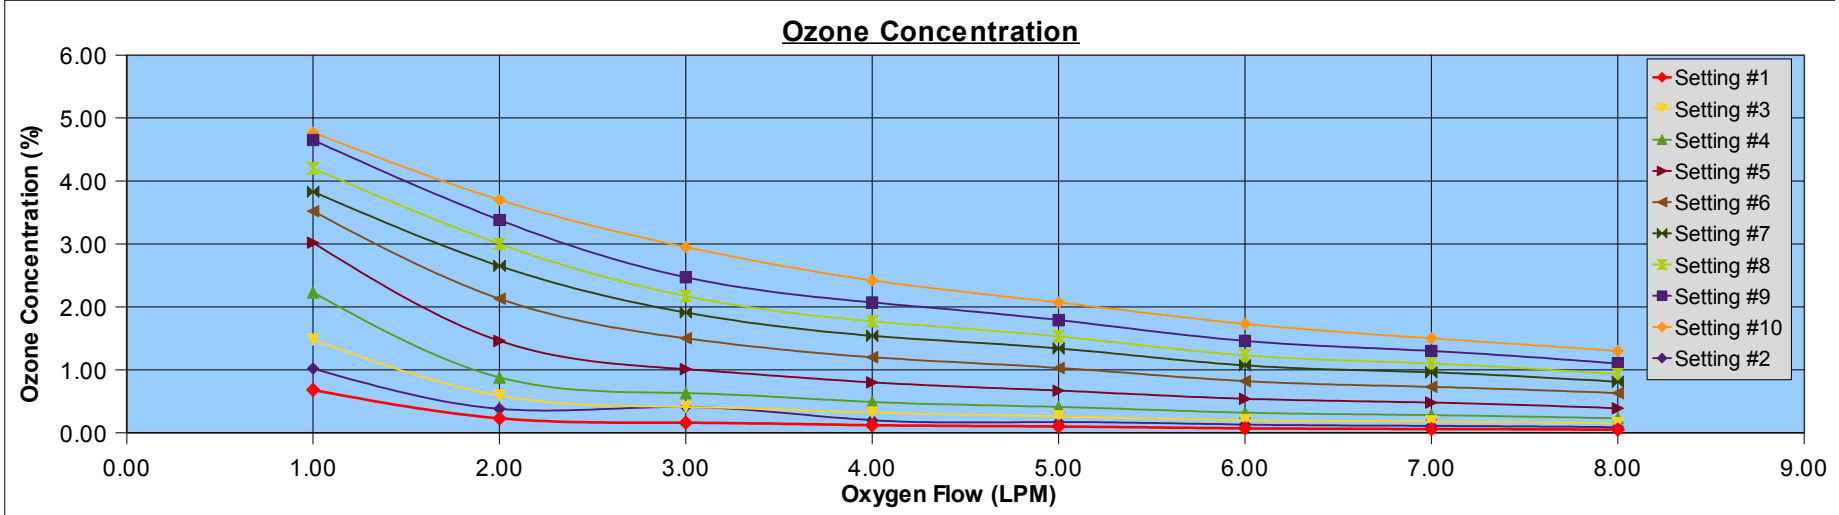

Test was performed at 72°F, Generator was ON for more than 1 hour.
 Ozone Analyzer API-460H & API-454