


TS-40 Ozone Generator Performance


TS-40 Ozone System

Oxygen Flow in LPM	Ozone Concentration, % by weight	Ozone Production in g/hr
2.00	6.80	11.67
3.00	6.60	16.99
6.00	6.10	31.40
8.00	5.40	37.07
10.00	4.90	42.04

Ozone Concentration

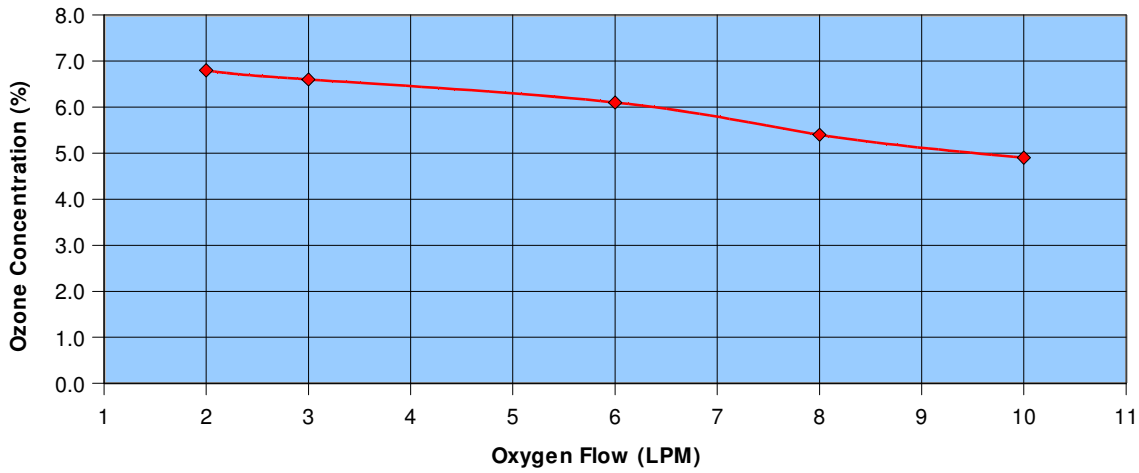

Ozone Production

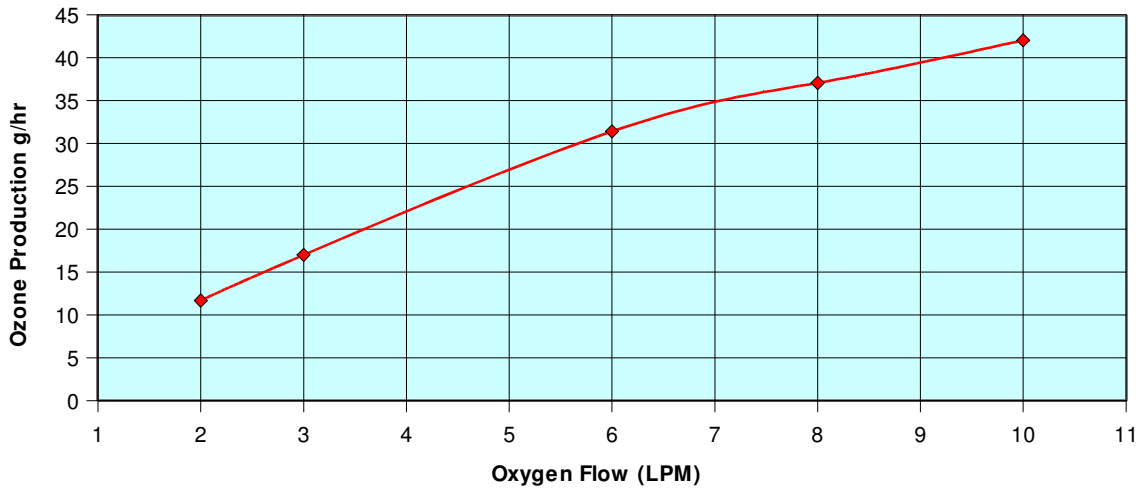

All tests were performed at 70-deg F

Ozone Generator was run at each flow rate for 1 hour prior to recording reading